

成品出厂前抽样检验测试报告


Random Check/Test Report on Finished Product Before Loading

抽样工号 Project No	案名 Project Name	测试日期 Test Date	品名规格 Panel Type

单块地板重量 Weight of a single floor panel			
地板 Panel 1	地板 Panel 2	地板 Panel 3	地板 Panel 4

测试依据 Test Method		
☐ GB/T 36340-2018 (国标)	☐ CISCA 2007 (American Standard)	☐ BS EN 12825:2001 (European Standard)
☐ KS F 4760 (Korean Standard)	☐ JIS A 1450:2005 (Japanese Standard)	

测试点位示意图 Test Point

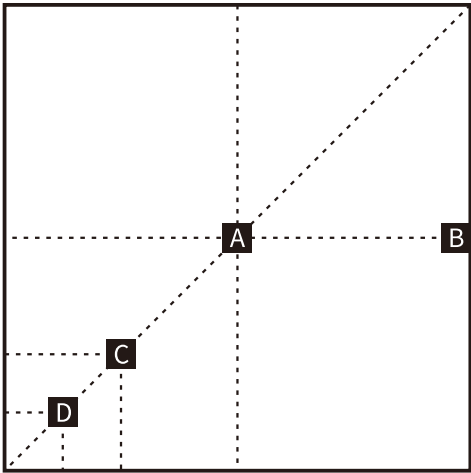

一片仅测一点 Only one point is tested on a single floor panel

荷载测试 Load Test (N)	Panel Center Point A	Panel Center Point B	Panel 1/4 Point C	Panel 70x70mm Corner Point D
1980N(445LB)				
3560N(800LB)				
4450N(1000LB)				
5560N(1250LB)				
6672N(1500LB)				
8896N(2000LB)				
11120N(2500LB)				
13345N(3000LB)				
15568N(3500LB)				
17793N(4000LB)				
20017N(4500LB)				
22241N(5000LB)				

选择性测试项目 Selected Test Items (Optional)

☐	N (客户要求的荷载) 释放压力后永久变形量 Release of stress permanent deflection by client			
	Panel Center Point A (mm Deflection)	Panel Center Point B (mm Deflection)	Panel 1/4 Point C (mm Deflection)	Panel 70x70mm Corner Point D (mm Deflection)

☐	破坏性能测试 Destructive performance testing			
	Panel Center Point A (N Breakage)	Panel Center Point B (N Breakage)	Panel 1/4 Point C (N Breakage)	Panel 70x70mm Corner Point D (N Breakage)

☐	导电值 Conductivity (单位:MΩ) (1) x (10 ⁴) -1x10 ⁹ Ω 500V			
	地板 Panel 1	地板 Panel 2	地板 Panel 3	地板 Panel 4

☐	外形检测 Appearance inspection			
	长/宽度 Length/Width (599.6~600mm)	高度 Height (目标厚度±0.3mm)	地板初始平坦度, Initial floor flatness Edge<0.5mm, Diagonal<0.75mm	外观视觉效果 Visual appearance of Floor Panel
	地板 Panel 1			
	地板 Panel 2			
	地板 Panel 3			
	地板 Panel 4			

判定结果 Judgment result:

测试人 Test Manager: 陈崴 制表 Inspector: 顾旭翔

质检部公章
Official seal of the Quality
Inspection Department